
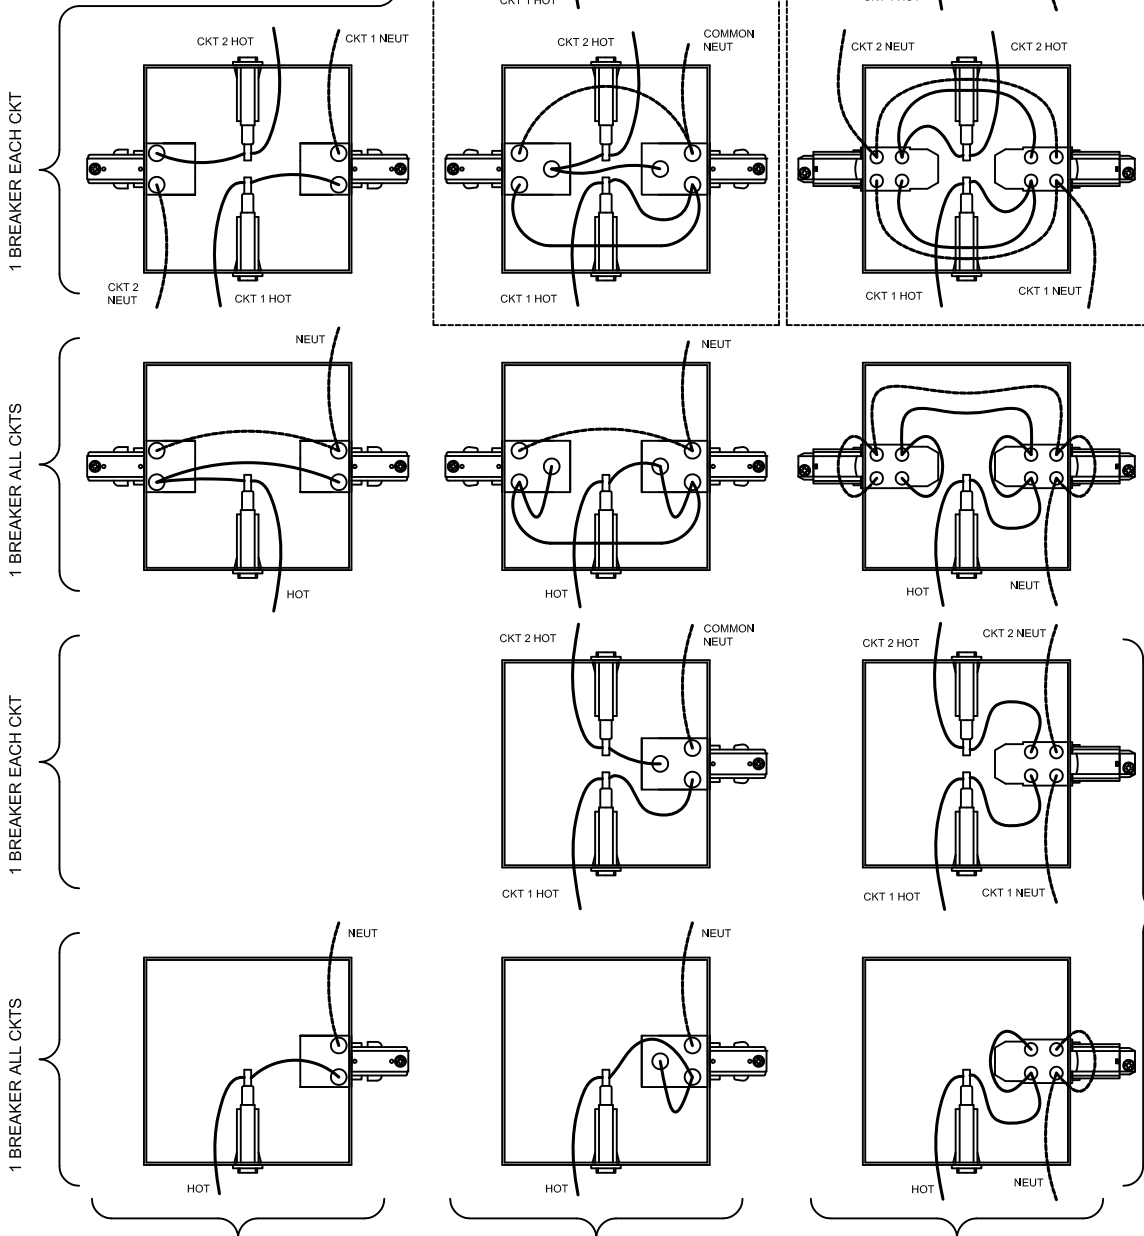


CURRENT LIMITER INSTALLATION INSTRUCTIONS FOR NON LINEAR MODELS

CAUTION: This product is to be installed according to national and local electrical codes and by qualified personnel only!
CAUTION: Disconnect power before installing this equipment!
STEP 1: Install current limiter to junction box (Diagram #1), or install to mounting surface and use 1/2" knockouts provided to install armored cable, conduit, or other approved means of supplying power (Diagrams #2, #3 or #4).
STEP 2: Connect all green wires to system ground.
STEP 3: Connect the hot and neutral feeder wires to the hot and neutral current limiter circuits. Use the diagrams below to assist in the proper connection of the current limiter. **NOTE:** For certain installations it may be necessary to change the factory provided wiring scheme.

TIMES SQUARE LIGHTING INC.
 5 HOLT DRIVE, STONY POINT, NY 10980
 845-947-3034 FAX: 845-947-3047
 www.tsilight.com

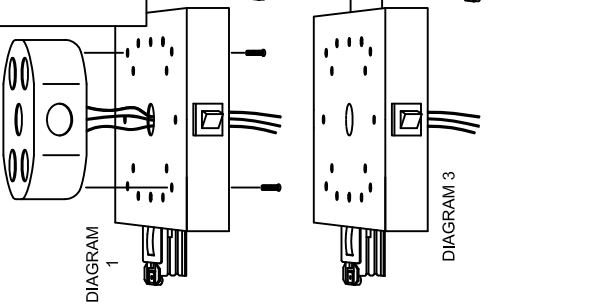

ALL GRADES 1 CKT TRACK FEEDER

COMMERCIAL GRADE 2 CKT TRACK FEEDER

SPECIFICATION GRADE 2 CKT TRACK FEEDER (NOTE: 277 volt models use larger housings and circuit breakers, but the wiring scheme is the same)

THERE ARE 3 COMMON CONFIGURATIONS FOR 2 CIRCUIT COMMERCIAL GRADE CURRENT LIMITERS WITH FEED THRU. THE FACTORY SUPPLIED VERSION IS THE LOWER CONFIGURATION.

THERE ARE 2 COMMON CONFIGURATIONS FOR 2 CIRCUIT SPECIFICATION GRADE CURRENT LIMITERS WITH FEED THRU. THE FACTORY SUPPLIED VERSION IS THE LOWER CONFIGURATION.

END FEED MODELS

THIS DRAWING IS THE PROPERTY OF TIMES SQUARE LIGHTING, INC. ANY UNAUTHORIZED USE IS PROHIBITED. SPECIFICATIONS SUBJECT TO CHANGE WITHOUT NOTICE. COPYRIGHT © TIMES SQUARE LIGHTING, INC., 2014. ALL RIGHTS RESERVED.

FEED THRU MODELS (NOTE: 180° PATTERN SHOWN. TRACK FEEDERS MAY ALSO BE PROVIDED IN A 90° PATTERN)

INSTR 0004