


Fixture manufacturer to provide minimum 18 AWG of Lutron EcoSystem wire tail (labeled E1 and E2) to junction box. Consult Lutron for field wiring.



Adapter is configured at OEM factory for EcoSystem inputs.

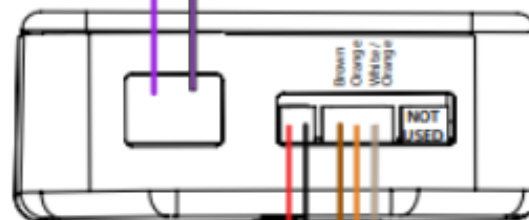

Digital Control Adapter



PN: 28.020.002.01  
Minimum requirement is a DMX type wire.

PN: 28.002.001.01

Brown is Digital Common.  
Orange is Data Negative.  
White with Orange Stripe is Data Positive.

White/Blue and Gray/Violet 0-10V wires are left open

FIXTURE

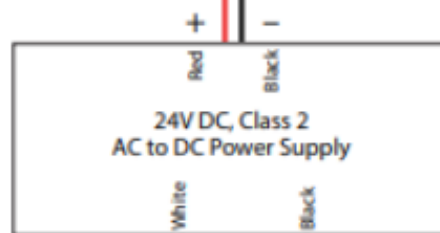

Line in Voltage  
(refer to power supply)

White Black  
Neutral Hot

The Constant Hot/Live must not be wired to a switching device. This may be put on a relay for maintenance.